

# PERMIT

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH\*

HOWARD COUNTY

BUREAU OF ENVIRONMENTAL HEALTH

992-2330 461-9930

ELLICOTT CITY

DISTRICT \_\_\_\_\_

DATE 1/8/85

P 34756

A REPAIR

*approved  
1-28-85 CW*

*1/25/85  
1-2 PM Inapt*

INDEXED

Bud Arnold IS PERMITTED TO INSTALL \_\_\_\_\_ ALTER X

ADDRESS Woodbine, Maryland 21797 PHONE 795-1285

SUBDIVISION \_\_\_\_\_ ROAD 1805 Marriottsville LOT \_\_\_\_\_

PROPERTY OWNER ROLAND MAXWELL Carl Mr. ~~Myers~~ Myers PHONE: 442-1774

ADDRESS FORMER OWN 1805 Marriottsville Road  
Marriottsville, Maryland 21104

IF GARBAGE GRINDER IS USED INCREASE SEPTIC TANK CAPACITY BY 50% AND ABSORPTION AREA BY 22%.

GARBAGE GRINDER? YES \_\_\_\_\_ NO ✓

SEPTIC TANK CAPACITY 1000 GALLONS NUMBER OF BEDROOMS 3

REPAIR - CALL FOR INSPECTION WHEN GROUND IS OPENED UP SO SANITARIAN CAN RECOMMEND REPAIR.

2nd driveway on right side North of Uk 99

System last repaired in 1964 (NOV 4) See Spec Sheet

PLANS APPROVED BY Frank Skinner DATE 1/8/85

COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COUNCIL NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

NOTE: IF TRENCH IS USED CALL FOR INSPECTION BEFORE AND AFTER PLACING GRAVEL IN TRENCH.

NOTE: NO DRY WELL SHALL EXCEED 15 FOOT IN DIAMETER. NO ABSORPTION TRENCH TO EXCEED 100 FEET IN LENGTH.

NOTE: ALL PIPE FROM HOUSE TO SEPTIC TANK MUST BE CAST IRON OR SCHEDULE 40 PVC OR ABS.

PERMIT VOID AFTER THREE YEARS.

NOTE: INSTALL STAND PIPE ON SEPTIC TANK AND DRY WELL. STAND PIPES MUST BE 6 INCHES IN DIAMETER. CAST IRON, CONCRETE OR TERRA COTTA, OR PVC OR ABS ACCEPTED. IF TOP OF SEPTIC TANK IS DEEPER THAN 3 FEET MANHOLE TO GRADE REQUIRED.

**\*INSTALLER IS RESPONSIBLE FOR OBTAINING FINAL APROVAL ON THIS PERMIT**

\*CALL 992-2330 FOR INSPECTION OF SEPTIC SYSTEMS.

EH - 2-1082

*Repair  
P 34756*



# PERMIT

11/4/66 - Approved. JHC

P 12235

A \_\_\_\_\_

SEWAGE DISPOSAL SYSTEM

MARYLAND STATE DEPARTMENT OF HEALTH

HOWARD COUNTY

ELLICOTT CITY

REPAIR

INDEXED

DISTRICT 3

DATE 10/10/66

\_\_\_\_\_ Emerson Feaga \_\_\_\_\_ IS PERMITTED TO INSTALL  ALTER \_\_\_\_\_

ADDRESS Triadelphia Rd., Ellicott City, Md. PHONE AT 6-2516

A SEWAGE DISPOSAL SYSTEM LOCATED AT \_\_\_\_\_

SUBDIVISION \_\_\_\_\_ ROAD Marriottsville Rd. - LOT \_\_\_\_\_

PROPERTY OWNER Roland Maxwell 1st entrance on right going toward Marriottsville

ADDRESS \_\_\_\_\_

SPECIFICATIONS - 4 bedrooms

DRAIN FIELD \_\_\_\_\_ DEPTH \_\_\_\_\_ FEET, BOTTOM AREA \_\_\_\_\_ SQ. FT.

SEEPAGE PITS \_\_\_\_\_ ABSORBENT SIDE-WALL AREA \_\_\_\_\_ SQ. FT.

SEPTIC TANK CAPACITY 1,000 GALLONS

FOR GARBAGE GRINDER, INCREASE DISPOSAL AREA 22% & TANK CAPACITY 50%.

OTHER Repair - 400 sq. ft. of either drain field or deep trench.

MAXIMUM DEPTH PERMITTED 10' from original grade.


PLANS APPROVED BY F. Frommelt DATE 10/10/66

FILL SEPTIC TANK AND DISTRIBUTION BOX WITH WATER BEFORE CALLING FOR AN INSPECTION. COVER NO WORK UNTIL INSPECTED AND APPROVED.

NEITHER THE HOWARD COUNTY COMMISSIONERS NOR THE HEALTH DEPARTMENT IS RESPONSIBLE FOR THE SUCCESSFUL OPERATION OF ANY SYSTEM.

## NOTIFY THE HEALTH DEPARTMENT 48 HOURS BEFORE EXCAVATIONS ARE TO BE BACK FILLED.

12235

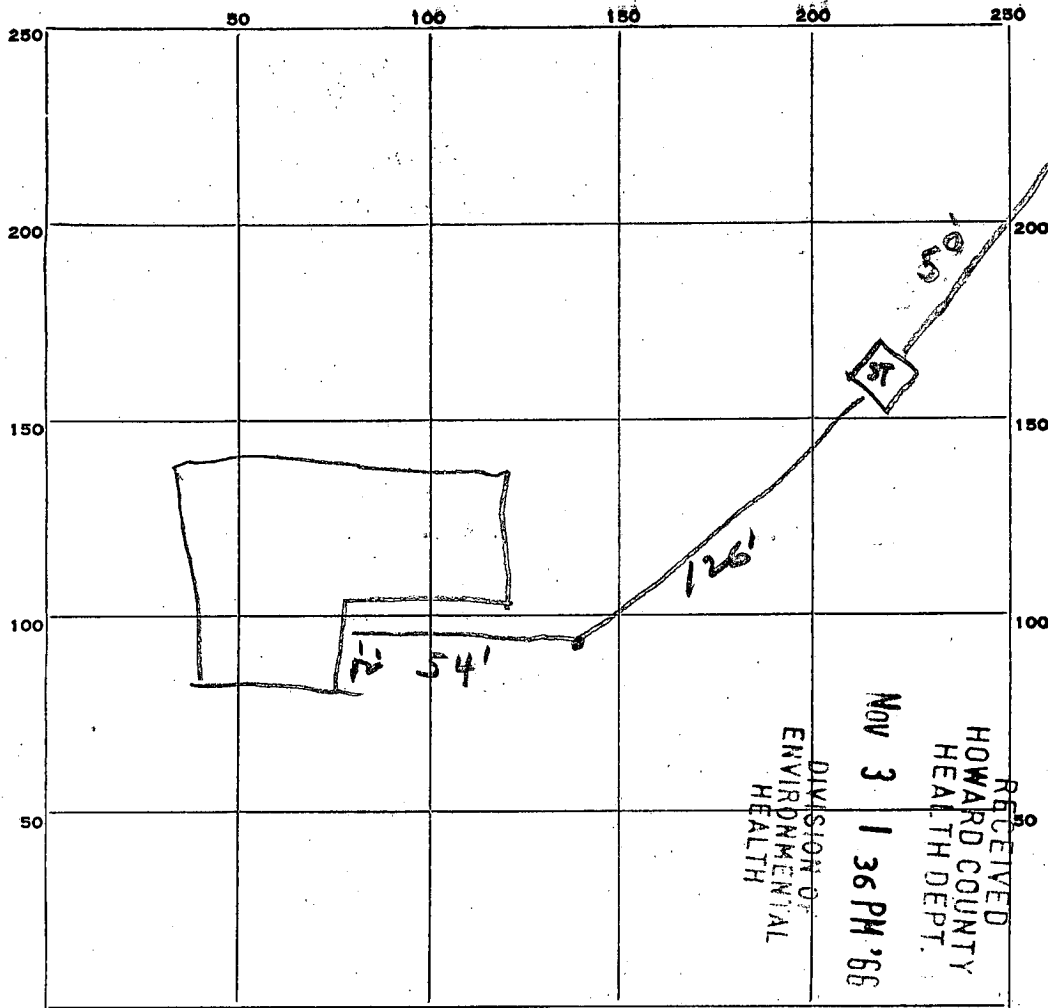

INDICATE NORTH. - NAME ADJOINING ROADWAY AS BASE LINE.

Marriottsville Rd.

PERMIT CARD \_\_\_\_\_

SEPTIC TANK, LEVEL \_\_\_\_\_ CLEANOUTS \_\_\_\_\_

DISTRIBUTION BOX, LEVEL \_\_\_\_\_

TILE FIELD, DEPTH 3 FT. TRENCH WIDTH 3 FT.

GRAVEL DEPTH 12 IN. TOTAL LENGTH 50 FT.

NUMBER OF TRENCHES 1 TOTAL BOTTOM AREA 150

SEEPAGE PITS, INSIDE DIAMETER 3' x 15' FT. DEPTH BELOW INLET 9 FT.

ABSORBENT AREA 270 SQ. FT. Total 420 sq ft

REMARKS \_\_\_\_\_

DATE SYSTEM APPROVED 11/4/66 INSPECTOR J. H. Kilmore

CARL MYERS

REPAIR

SUBDIVISION:

LOT NUMBER:

P 34756

DRY WELL OR DRY WELL AND TRENCH

1000 sq. ft./bedroom

	Septic Tank
3 bedroom	<u>1000 gallon</u>
4 bedroom	1250 gallon
5 bedroom	1500 gallon

Minimum Total square Feet

Inlet \_\_\_\_\_ feet below original grade.

Bottom maximum depth \_\_\_\_\_ feet below original grade.

Effective area begins at \_\_\_\_\_ feet below original grade.

NOTE: If trench is used to make up absorbent area, run the trench on level ground and leave a 5 foot earth buffer between dry well and trench. No trench is to exceed 100 feet in length. Trench inlet to be same as dry well, with \_\_\_\_\_ feet of stone below distribution pipe.

REPLACE PIPE FROM HOUSE TO TANK  
 REPLACE TANK OR TRENCHES SHALLOW  
 REPAIR TANK  
125 sq. ft./bedroom

Trench to be 3 wide.

Inlet 3 feet below original grade.

Bottom maximum depth 5 feet below original grade.

Effective area begins at 3 feet below original grade.

1/2 feet of stone below distribution pipe.

- NOTE:
- (1) No trench to exceed 100 feet in length.
  - (2) If more than one trench used, a distribution box is required.
  - (3) Trenches to be installed on level ground.
  - (4) Call for inspection of trench before gravel is installed.
  - (5) Provide 6"-8" diameter cleanout and cap to grade or above on septic tank and drywell.
  - (6) If a Garbage disposal is used, increase septic tank capacity by 50% and increase absorbant sidewall area by 22%.

LOCATION: 1-11-84 - PLACE THE TILE FIELD

BETWEEN PERC HOLE ① & ②, PERC HOLE

② IS LOCATED 69 FT FROM THE PORCH &

& 159 FT FROM THE OLD TANK PERC HOLE ①

IS LOCATED 100 FT FROM THE WELL AND

64 FT FROM FROM THE OLD TANK RA

IT IS NOT NECESSARY TO PUT IN A NEW TILE FIELD IF THE EXISTING IS WORKING.